

---

# EGANVILLE SEWAGE SYSTEM

---

## 2013 PERFORMANCE REPORT

---

Township of Bonnechere Valley  
Water and Sewage Department  
January 2014

---



# Eganville Sewage System – 2013 Performance Report

---

## Table of Contents

Executive Summary.....	3
Introduction .....	4
Report Availability.....	5
Eganville Sewage System .....	5
Operations .....	6
By-pass / Upsets / Abnormal Discharge Events .....	6
Maintenance .....	6
Calibration.....	6
Complaints .....	6
Effluent Quality Assessment .....	7
Capacity Assessment.....	8
Sludge Management.....	10

## Attachments

- Annual Verifications & Calibrations Report
- Monitoring Summary Report
- Sludge Management Report
- Processed Organic Waste Management System & Organic Soil Conditioning Site Report



## Eganville Sewage System – 2013 Performance Report

---

### Executive Summary

The Eganville Sewage System continues to operate in a manner that provides for the collection, transmission and treatment of sewage that meets all Municipal, Provincial and Federal standards.

The Eganville Sewage Treatment Plant processed 196,137 cubic metres of sewage in 2013 and the treated effluent discharged to the Bonnechere River met the Provincial Effluent Limits 100% of the time. The average day flow was 537 cubic metres.

The Biosolids Dewatering Facility processed 1,210 cubic metres of digested sludge in 2013 and generated 146 cubic metres of dewatered sludge which was transported to an Organic Soil Conditioning Site for utilization.

Both the liquid and dewatered sludge met the Provincial Standards for agricultural land application.

All reports required by applicable Acts, Regulations and Certificate's of Approval have been prepared and submitted.

All operational and process monitoring has been conducted in accordance with the Certificate's of Approval.



### Introduction

The collection, transmission, treatment and disposal of sewage in Ontario is regulated by the Ministry of the Environment (MOE) under the Ontario Water Resources Act (OWRA) and associated Regulations, Policy and Guidelines.

The current Certificate of Approval for the Eganville Sewage Works issued under Section 53 of the OWRA prescribes specific operational 'Terms and Conditions'.

Condition 10 requires the Owner to prepare and submit to the MOE District Manager a performance report, on an annual basis. The report must contain, but shall not be limited to, the following information:

- ✚ A summary and interpretation of all monitoring data and a comparison to the effluent limits outlined in Condition 7, including an overview of the success and adequacy of the Works;
- ✚ A description of any operating problems encountered and corrective actions taken;
- ✚ A summary of all maintenance carried out on any major structure, equipment, apparatus, mechanism or thing forming part of the Works;
- ✚ A summary of any effluent quality assurance or control measures undertaken in the reporting period;
- ✚ A summary of the calibration and maintenance carried out on all effluent monitoring equipment;
- ✚ A description of efforts made and results achieved in meeting Effluent Objectives of Condition 6;
- ✚ A tabulation of the volume of sludge generated in the reporting period, an outline of anticipated volumes to be generated in the next reporting period and an outline of the proposed sludge handling methods;
- ✚ A summary of any complaints received during the reporting period and any steps taken to address the complaints;
- ✚ A summary of all By-pass, spill or abnormal discharge events; and
- ✚ Any other information the District Manager requires from time to time.



## Eganville Sewage System – 2013 Performance Report

---

### Report Availability

A copy of this report shall be given, without charge, to every person who requests a copy from the Township of Bonnechere Valley Municipal Office at 49 Bonnechere St. E., Eganville, Ontario.

The report shall also be available on the Township of Bonnechere Valley website at [www.bonnecherevalleytwp.com](http://www.bonnecherevalleytwp.com)

### Eganville Sewage System

The Eganville Sewage System is owned and operated by the Township of Bonnechere Valley and provides for the collection and treatment of sewage for the residents and businesses of the Village of Eganville. The system generally consists of a piped collection system, four sewage pumping stations and a sewage treatment plant including a biosolids dewatering facility. The treated effluent is discharged into the Bonnechere River adjacent to the Eganville Sewage Treatment Plant located at 131 John Street, Eganville.

The Eganville Sewage System operates under an 'Amended Certificate of Approval issued on June 1, 2010, Number: 9566-85BHJK.

The Sewage Treatment Plant (STP) is an extended aeration secondary treatment process consisting of two circular package treatment units with a rated capacity of 1,080 cubic metres per day and a peak flow rate of 2,700 cubic metres per day.

The Biosolids Dewatering Facility utilizes Geotubes to dewater, stabilize and store the sludge generated by the STP. The resultant biosolids are land applied on approved biosolids utilization sites.



## Eganville Sewage System – 2013 Performance Report

---

### Operations

#### By-pass / Upsets / Abnormal Discharge Events

During 2013 the Eganville Sewage System did not have any by-passes, upsets or operating problems.

#### Maintenance

Ongoing maintenance included the following:

- Video inspection and cleaning of 880 metres of sewer including grit, root and grease removal.
- 8 sewer manhole improvements to reduce infiltration including replacing riser rings and paving.
- Air blower unit replacement at the Sewage Treatment Plant.

#### Calibration

All flow meters and lab instruments were calibrated, including any required maintenance, by a qualified and manufacturer approved technician. The following reports are attached:

- The 'Annual Verifications & Calibrations Report - Nov. 2013'.

#### Complaints

No complaints were received regarding the operation of the Eganville Sewage System.



## Eganville Sewage System – 2013 Performance Report

### Effluent Quality Assessment

The following table outlines the effluent objectives and limits as listed in the Certificate of Approval for the Eganville Sewage Treatment Plant:

Effluent Parameter	Effluent Objectives		Effluent Limits	
	Concentration mg/l	Loading kg/day	Concentration mg/l	Loading kg/day
CBOD <sub>5</sub>	15	16.2	25	27
Total Suspended Solids	15	16.2	25	27
Total Phosphorus	1.0	1.1	1.0	1.1
Total Ammonia Nitrogen	5.0	5.4	5.0	5.4
E. coli	200 counts/100ml		200 counts/100ml	
pH	6.5 to 8.5 at all times		6.0 to 8.5 at all times	

The following table provides an overview of the monitoring results for the effluent parameters.

- A detailed 'Monitoring Summary Report' is appended.

Effluent Parameter	Concentration mg/l	Loading kg/day
CBOD <sub>5</sub>	3	1.06 – 2.49
Total Suspended Solids	6 - 10	2 - 7
Total Phosphorus	0.07 - 0.28	0.03 – 0.11
Total Ammonia Nitrogen	0.01 – 2.32	0.01 – 1.19
Un-ionized Ammonia	0.005 – 1.4 ug/l	
E. coli	2 – 7 counts/100ml	
pH	6.43 – 7.02	

During 2013 all effluent 'Limits' were achieved 100% of the time. All effluent 'Objectives' were also achieved with the exception of pH which was slightly below the Objective of 6.5 on a number of occasions.



## Eganville Sewage System – 2013 Performance Report

The efficiency of the sewage treatment process can be shown by the % removal of the following indicator parameters:

PARAMETER	AVERAGE % REMOVAL
BIOCHEMICAL OXYGEN DEMAND	97.44
TOTAL SUSPENDED SOLIDS	94.38
TOTAL PHOSPHORUS	95.88

### Capacity Assessment

The Sewage Treatment Plant's rated capacity of 1,080 cubic metres per day and the peak flow rate of 2,700 cubic metres per day were not exceeded in 2013.



Based on the average daily flow of 537 cubic metres, 49.7% of the Sewage Treatment Plant's capacity was utilized.

FLOWS			
MONTH 2013	MONTHLY TOTAL	AVG.DAY	MAX DAY
	X1000m3	X1000m3	X1000m3
JAN.	14.597	0.471	0.857
FEB.	14.696	0.525	0.758
MAR.	18.681	0.603	0.957
APR.	27.978	0.933	1.197
MAY	20.469	0.660	0.807
JUN.	21.479	0.700	1.355
JUL.	18.122	0.585	0.818
AUG.	14.288	0.461	0.791
SEP.	10.489	0.350	0.430
OCT.	11.250	0.363	0.461
NOV.	11.191	0.373	0.442
DEC.	12.897	0.416	0.664
TOTAL	196.137		
AVERAGE	16.345	0.537	0.795
MAX	27.978	0.933	1.355
<b>LIMITS</b>		<b>1.080</b>	<b>2.700</b>





## Eganville Sewage System – 2013 Performance Report

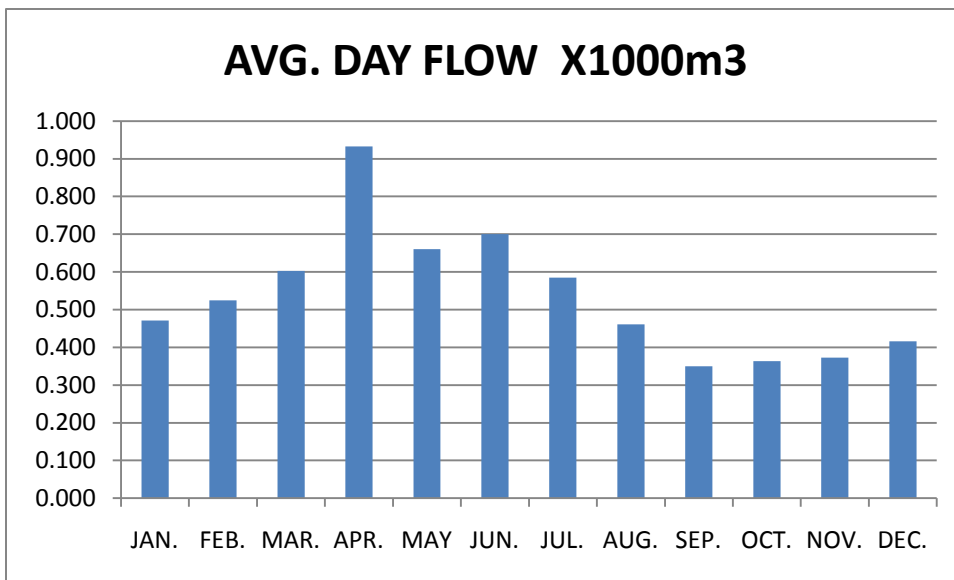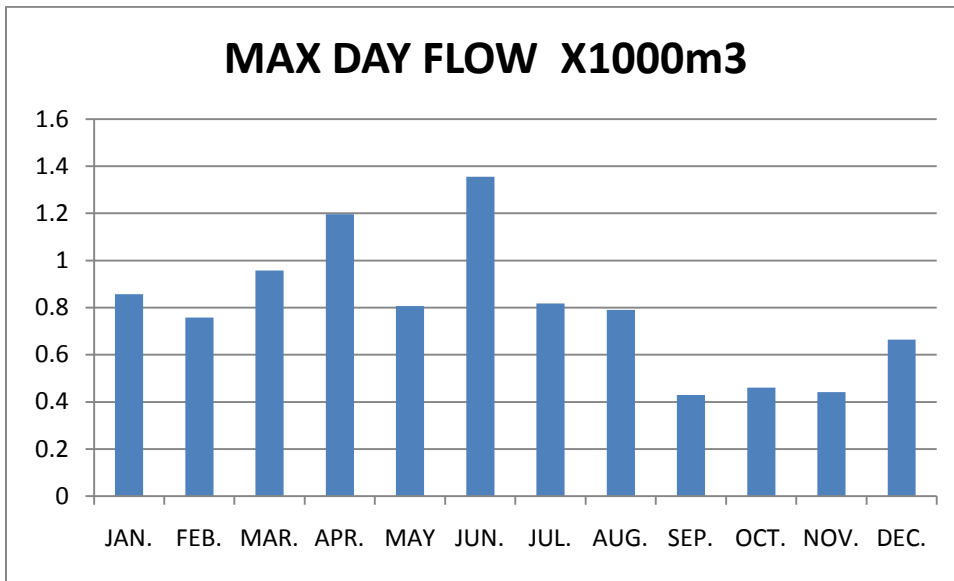



### Sludge Management

Aerobically digested sludge is transferred from the digester to the Biosolids Dewatering Facility on a regular basis for processing. The sludge is mixed with a polymer and pumped into Geotubes for dewatering. The resultant filtrate is returned to the inlet of the Sewage Treatment Plant. Once the solids capacity of a Geotube is reached it is allowed to sit for several months before the contents are removed and transported to an approved Organic Soil Conditioning Site for utilization.

- The attached 'Sludge Management Report' for 2013 provides the volumes, analysis and disposition of the material.
- The attached 'Waste Management System & Organic Soil Conditioning Site Report' for 2013 provides additional detail.

It is anticipated that sludge generation, processing and disposal operations will be similar in 2014.